


REVISIONS				
REV	ZONE	DESCRIPTION	DATE	APPROVED

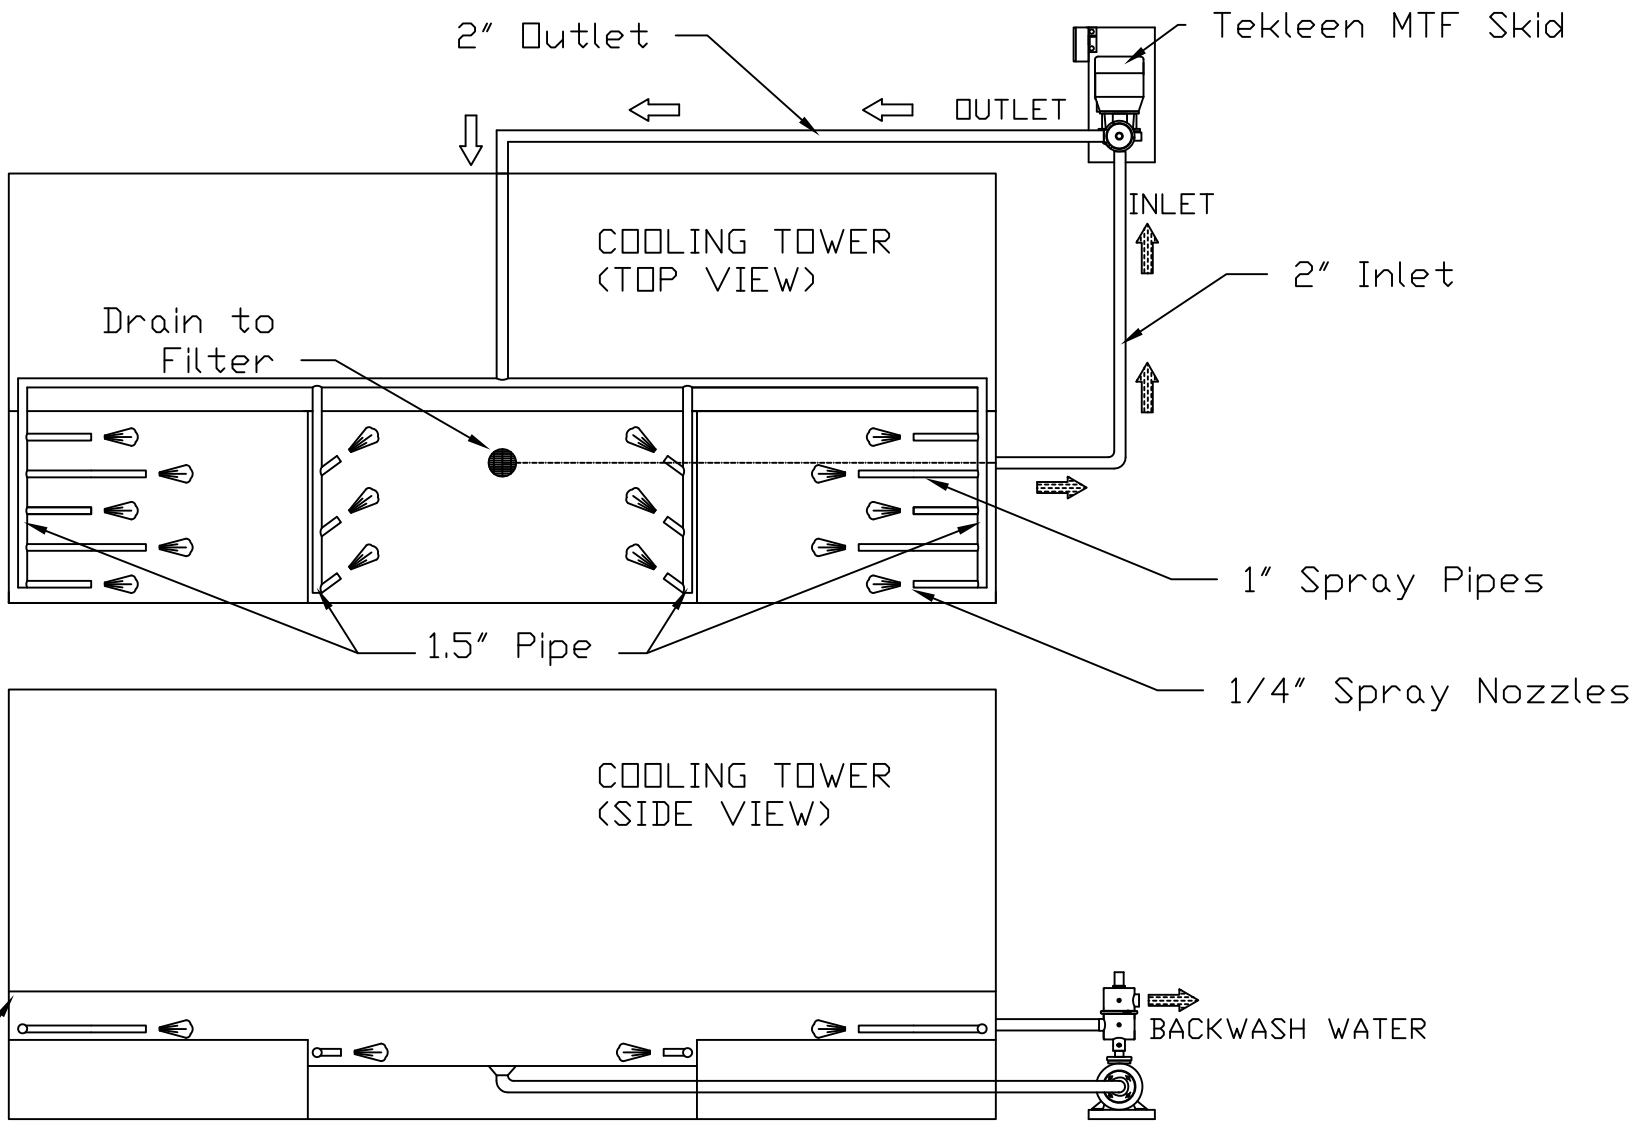

Water level must remain 2" above spray nozzles

UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES TOLERANCES DECIMALS    ANGULAR .XX ± .05    ± 0.5 DEG. .XXX ± .01		AUTOMATIC FILTERS, INC. 2672 S. LA CIENEGA BLVD. LOS ANGELES, CA 90034 (310) 839-2828 FAX (310) 839-6878		
DRAWN S. PERKINSON	DATE 05/11/11	TITLE MTF SKID UNIT - COOLING TOWER SWEEPER, LAYOUT DRAWING		
CHECKED		SIZE A	DWG NO. SKID-MTF-LAY-CTS-01	REV N/A
DESIGN		NOT TO SCALE		SHEET 1 OF 1